



TYPICAL SUMP & COOLING TOWER ARRANGEMENT

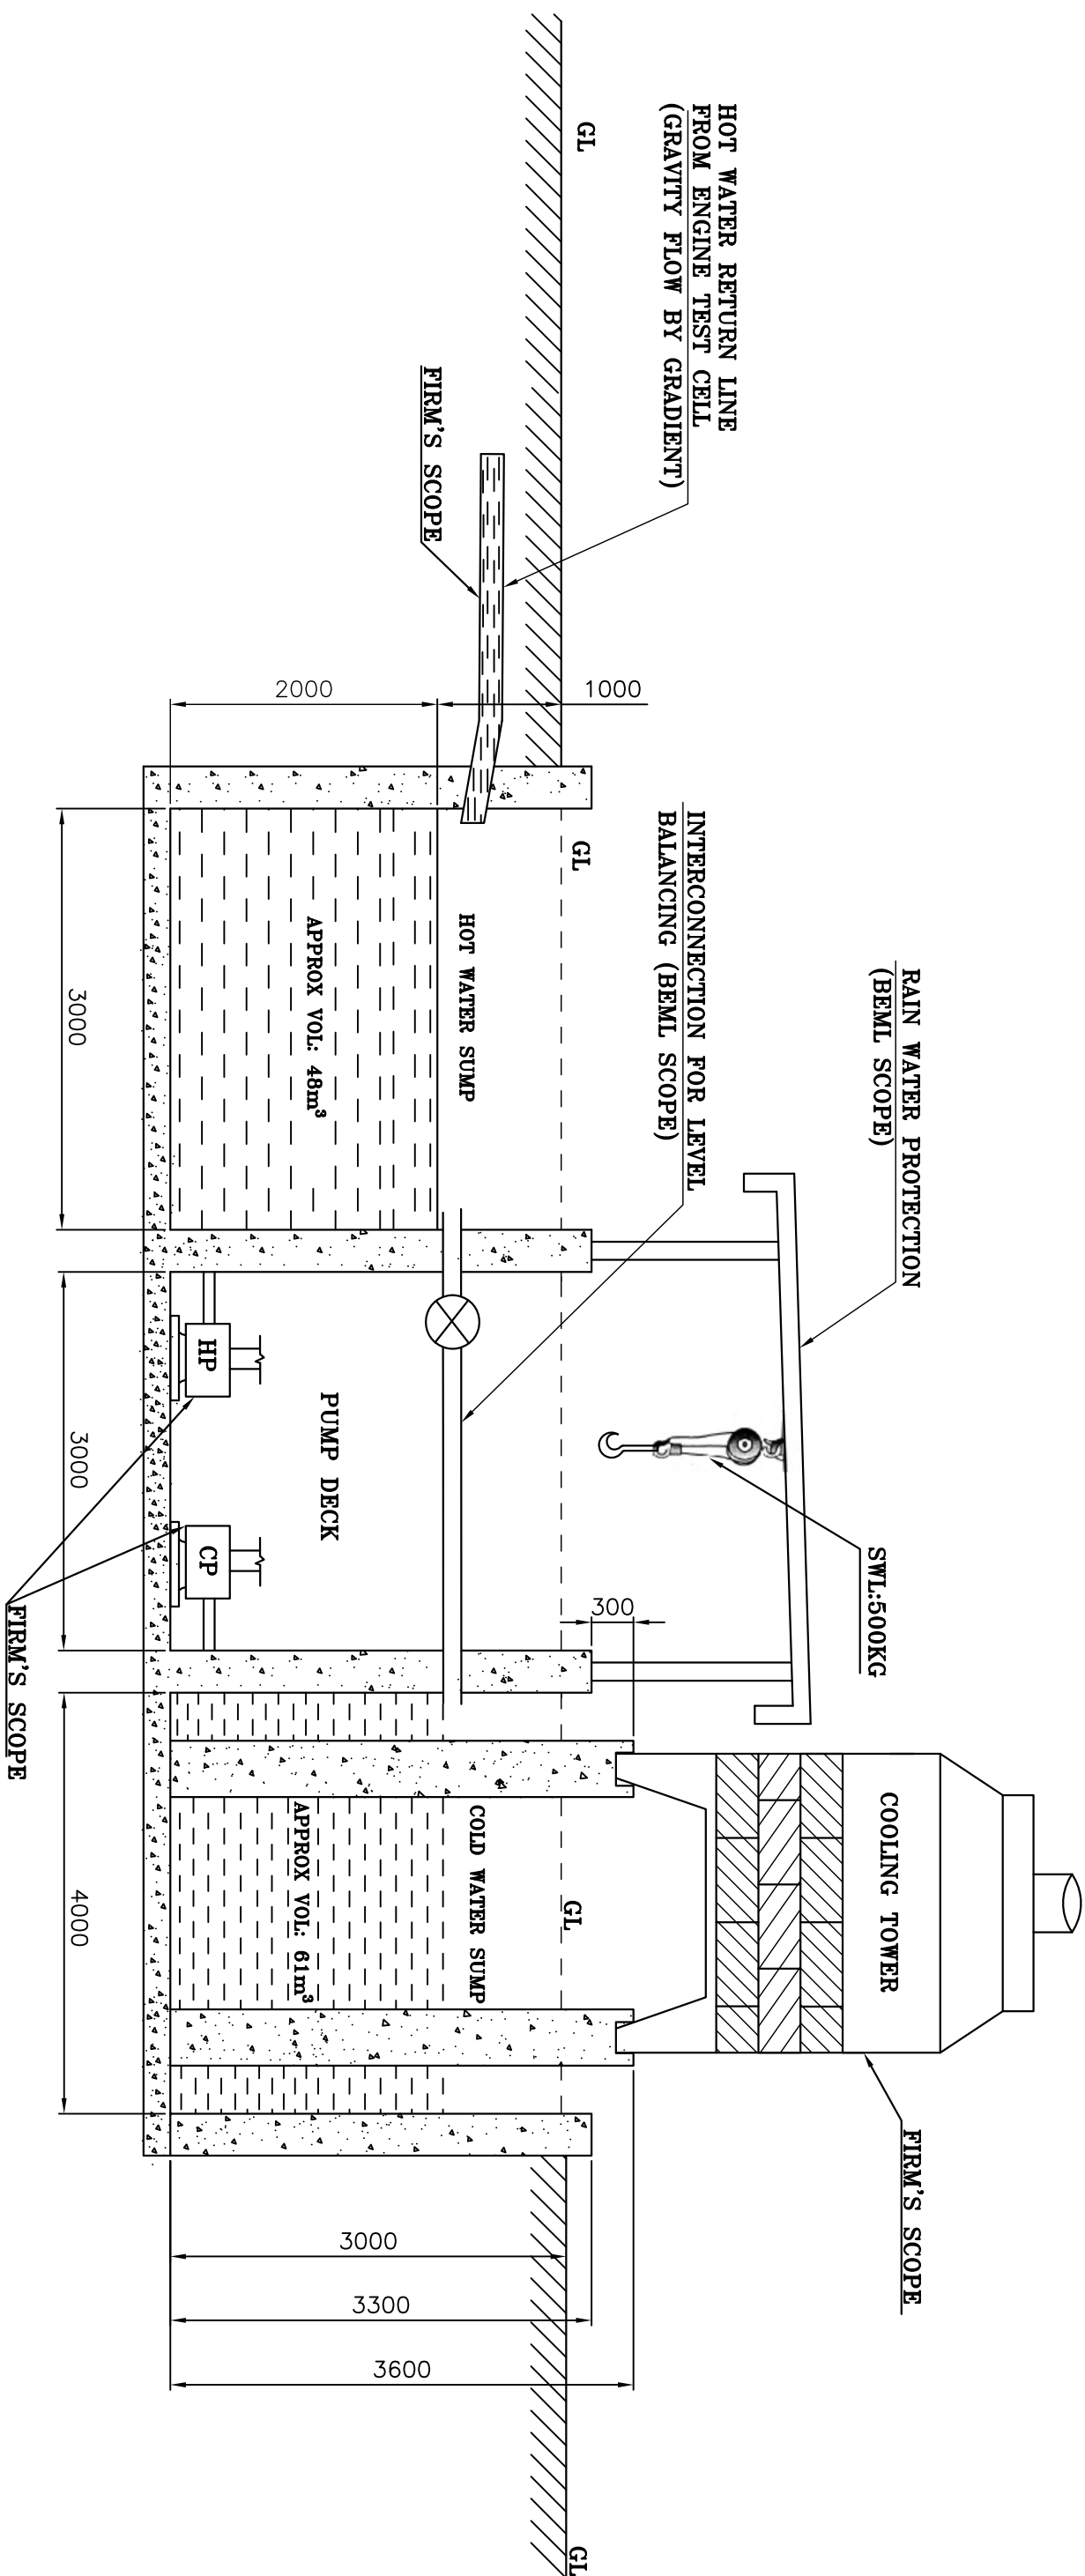


NOTE: BEML WILL CONSTRUCT COLD WATER SUMP, HOT WATER SUMP AND PUMP DECK AS PER ABOVE DIMENSION. 8 RCC PILARS WILL BE PROVIDED IN COLD WATER SUMP AS PER THE DRAWING FOR INSTALLATION OF TWO COOLING TOWER UNITS. FIRM TO MAKE NECESSARY ADAPTATION WORK TO INSTALL COOLING TOWERS ON THESE COLUMNS. FOR INSTALLATION OF PUMPS,  $\phi 5''$  FLANGED PIPE INSERTS 4no's EACH FOR COLD WATER & HOT WATER PUMPS WILL BE EMBEDDED IN THE CONCRETE WALL OF SUMP. FURTHER PUMP & PIPE LINE WORK TO BE EXECUTED BY THE FIRM AS PER TENDER SCOPE.

TYPICAL WATER SUMP AND PUMP DECK ARRANGEMENT

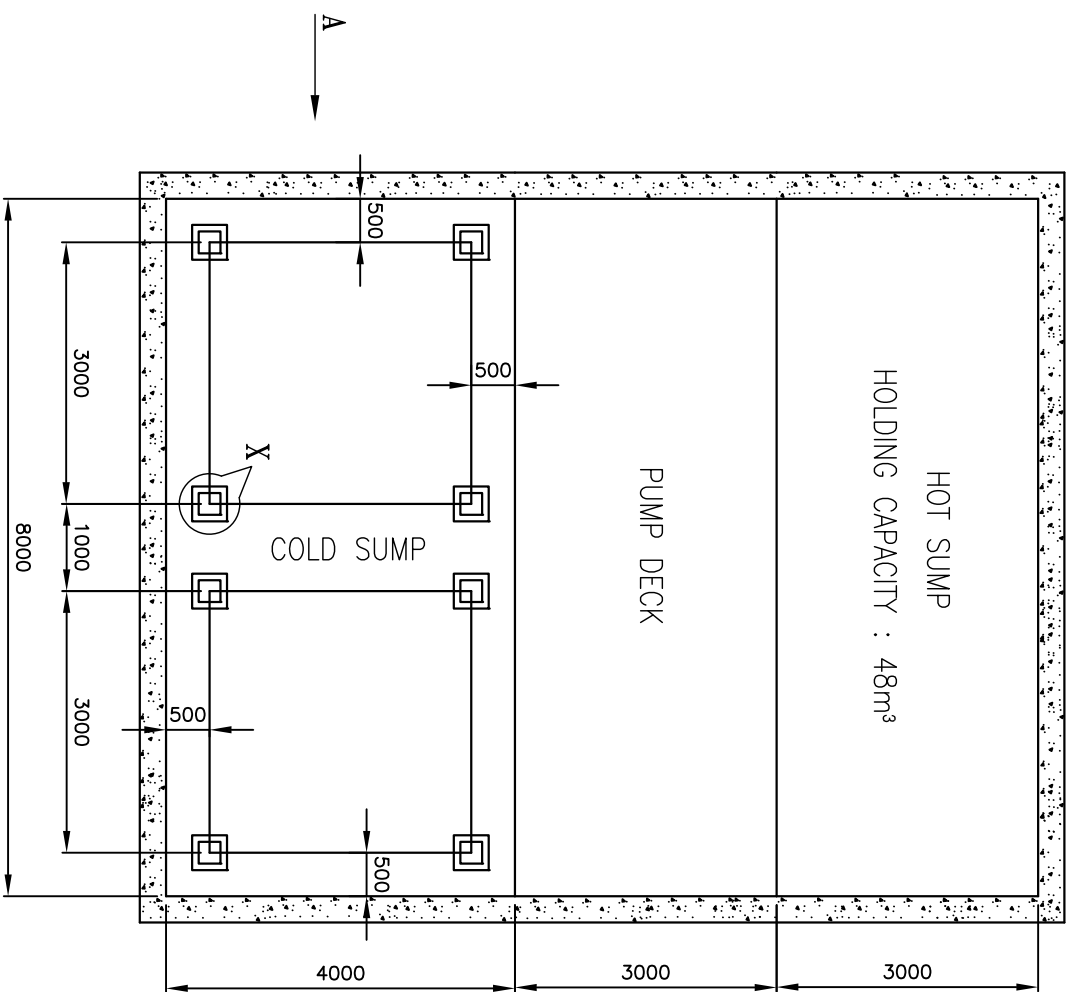

FOUNDATION DETAILS

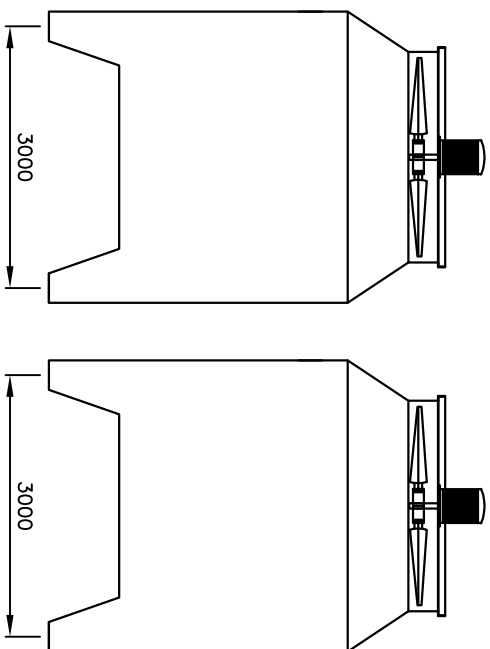

COOLING TOWERS (2 Nos)

