


ANNEXURE - P

ROOF EXTRACTOR FANS AND FRESH AIR FILTERS

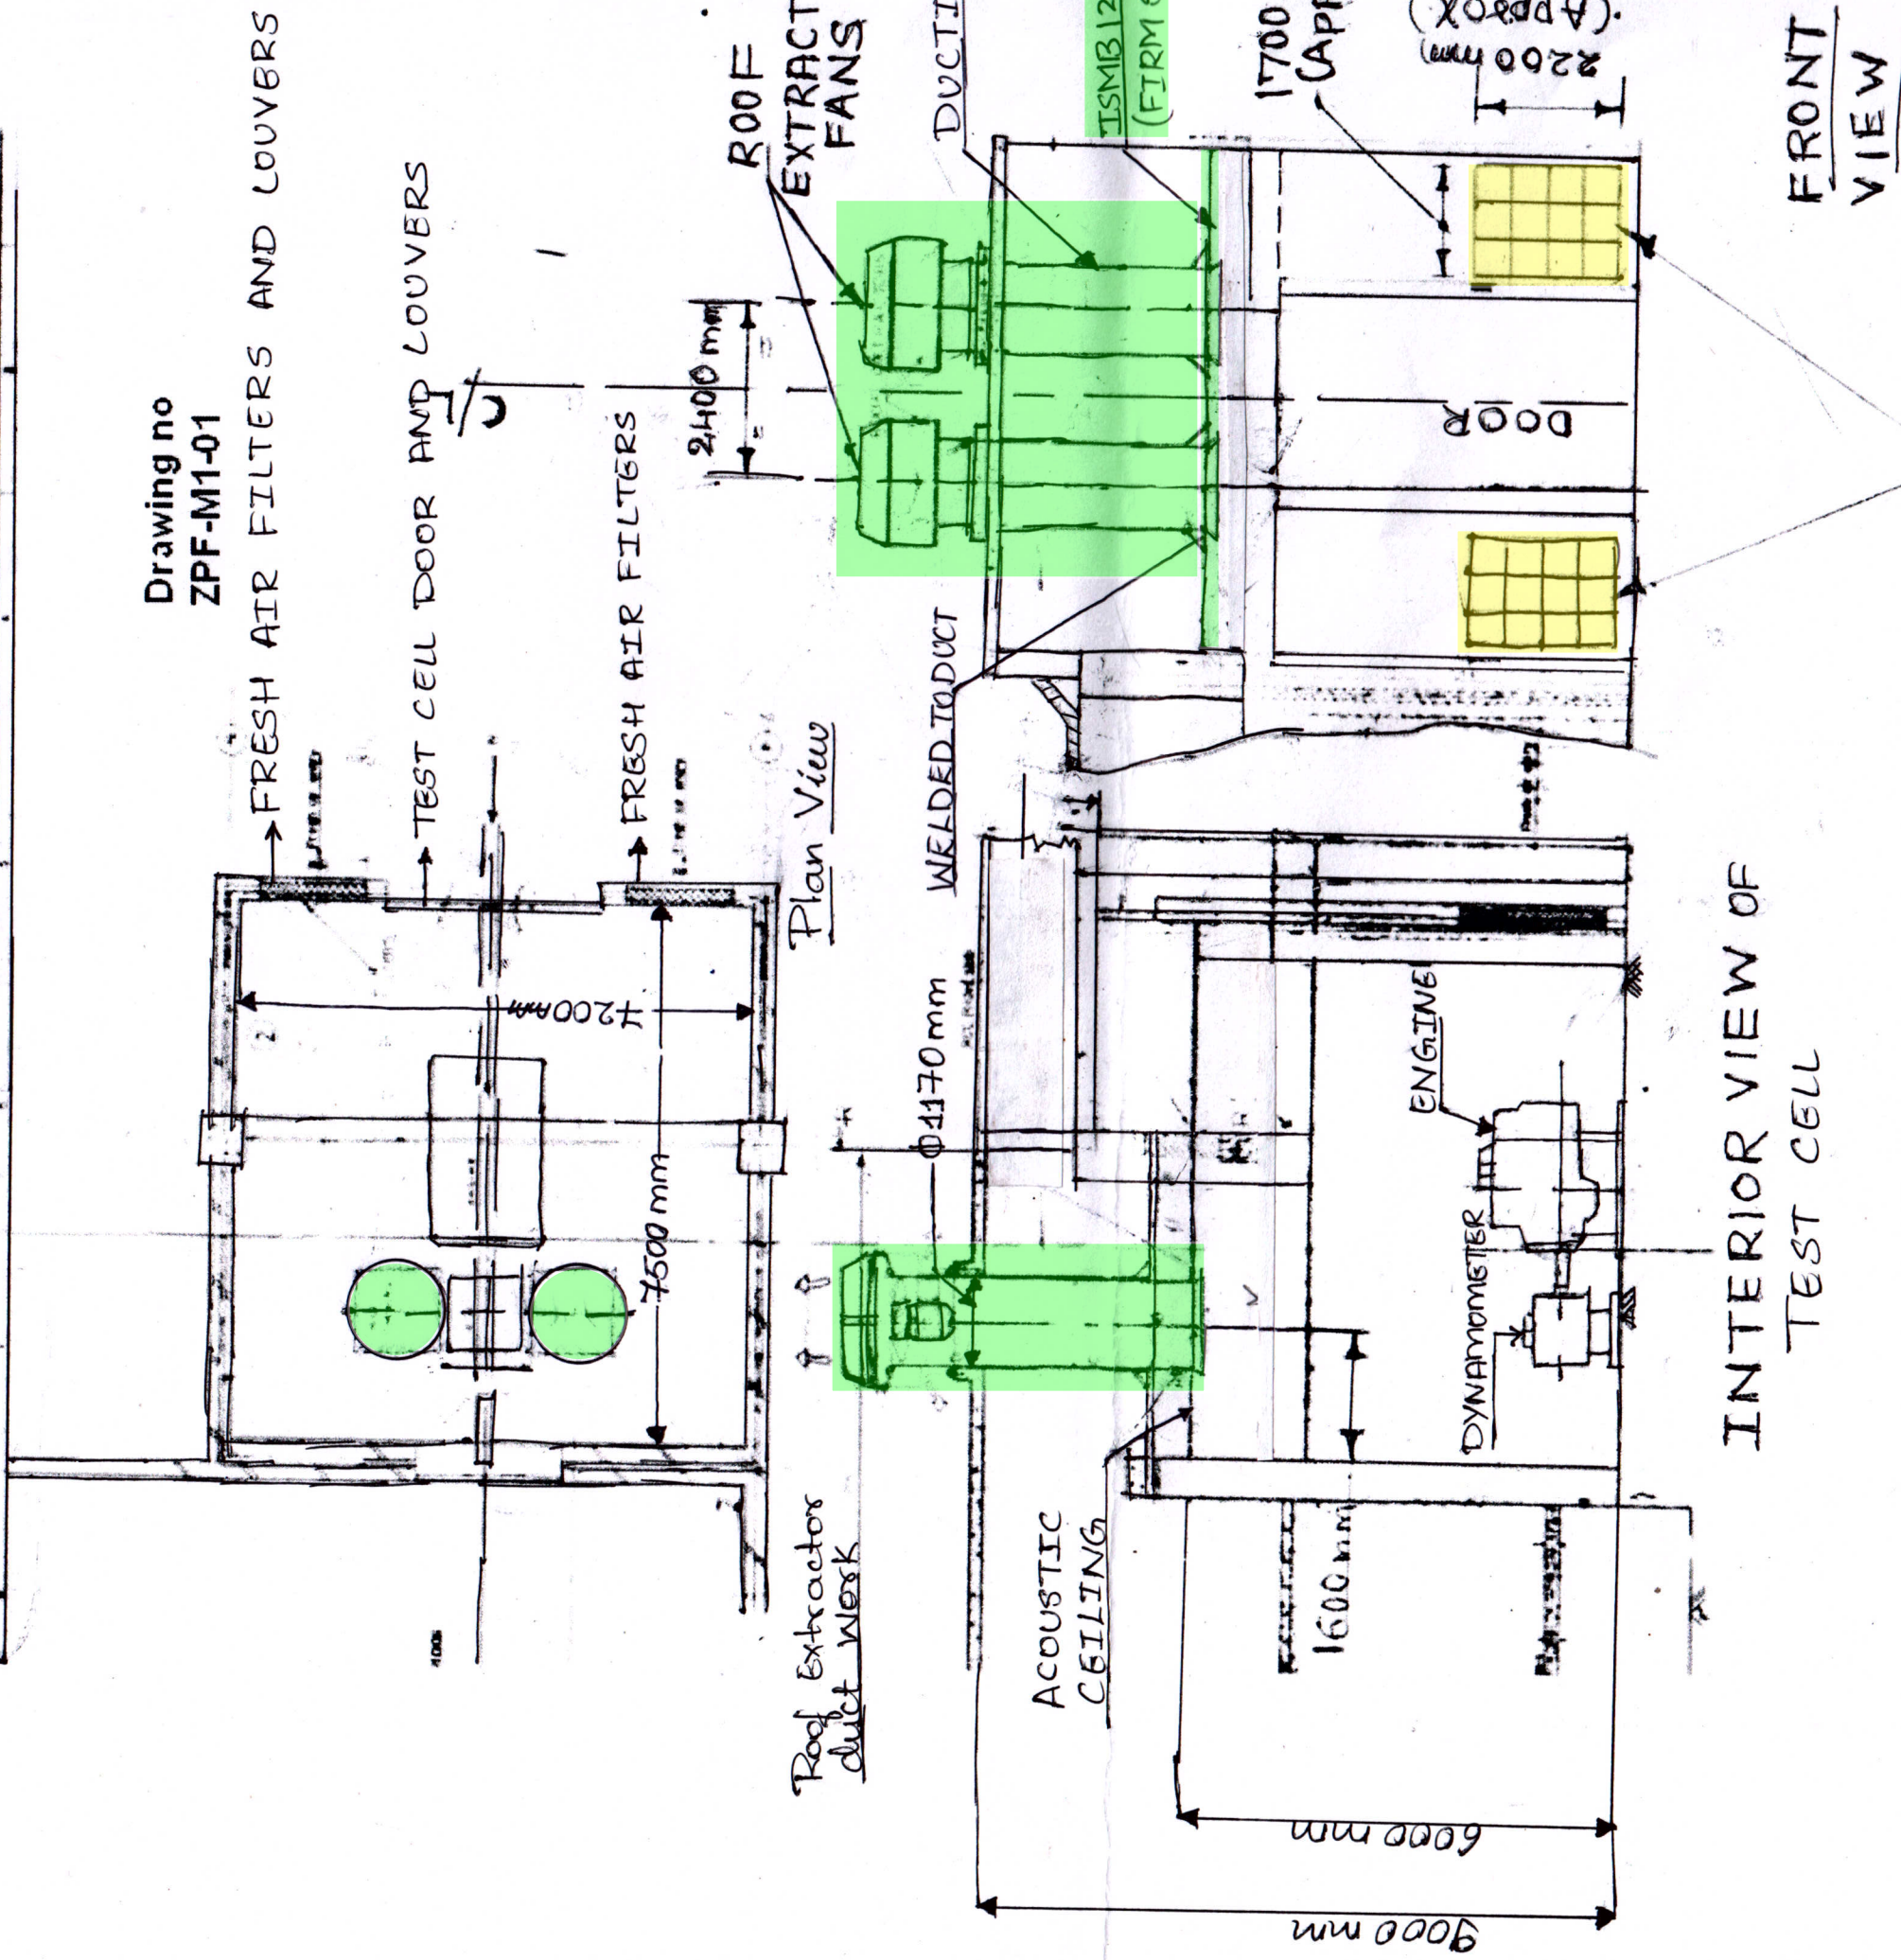

Note:- The necessary support structure for ducting is the scope of the firm.